



SGS U.S. Testing Company Inc.

291 Fairfield Avenue
Fairfield, NJ 07004-3833
Tel: 973-575-5252
Fax: 973-244-1694

Report Number: 122619
Date: 03/31/99
Page: 1 of 1

CLIENT: *NeoPoxy Corporation*

REPORT OF TEST

SUBJECT: One (1) sample received on 03/29/99 and identified by the client as:
Concrete

AUTHORIZATION: Client's Purchase Order #IP0-2270. *NPR-5303*

PURPOSE: To test the pull-off strength of a coating on the concrete.

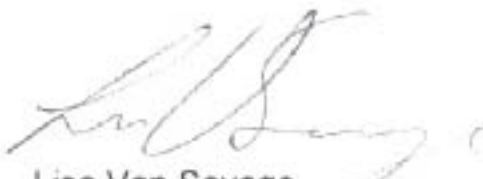
TEST DATE: 03/30/99

PROCEDURE: Testing was conducted in accordance with ASTM D-4541.


RESULTS: Force Required for Failure

Trial 1	60 Kg/cm ²	1000 lb/in ²
Trial 2	60 Kg/cm ²	1000 lb/in ²
Trial 3	60 Kg/cm ²	1000 lb/in ²

All trials concrete failed.


Lisa Van Savage
Manager, Chemistry Department
/ls

SIGNED FOR THE COMPANY BY:


For Joseph Kwiatkowski
Director, Chemistry Department

Member of the SGS Group